



Review Article

PERFORMANCE OF EARTH TUBE HEAT EXCHANGER COOLING OF AIR—A REVIEW

Ashish Kumar Chaturvedi^{1*} and V N Bartaria¹

*Corresponding Author: Ashish Kumar Chaturvedi, ✉ achaturvedi452@gmail.com

The temperature of earth at a certain depth about 2 to 3 m the temperature of ground remains nearly constant throughout the year. This constant temperature is called the undisturbed temperature of earth which remains higher than the outside temperature in winter and lower than the outside temperature in summer. When ambient air is drawn through buried pipes, the air is cooled in summer and heated in winter, before it is used for ventilation. The earth air heat exchanger can fulfil in both purpose heating in winter and cooling in summer. This paper investigates the experimental studies on earth air heat exchanger system in parallel connection in the summer climate. In the proposed work to investigate the experimental studies on earth tube heat exchanger cooling of air in summer and heating with air in winter climate in LNCT Energy Park Raisen Road Bhopal, M.P.

Keywords: Earth tube heat exchanger, Investigations, Cooling air

INTRODUCTION

The Energy consumption of buildings for heating and cooling purpose has significantly increased during the decades. Energy saving are of major concern everywhere is a particular challenge in desert climates. The desert climate can be classified as hot and arid and such condition exists in a number of areas throughout the world. In general most people feel comfortable when the temperature is between 20 °C and 26 °C and relative humidity is within the range of 40 to 60%. These conditions are often achieved through the use

of air conditioning. Air conditioning system is widely employed for the comfort of occupant as well as the industrial productions. It can be achieved effectively by vapour compression machines, but due to the depletion of ozone layer and global warming by using chlorofluorocarbons and the need to minimize high grade energy consumption various passive techniques are now a day's introduced, one such method is earth air heat exchanger. An earth air heat exchanger consists in one or more tubes laid under the ground in order to cool in summer or pre-heat in winter

¹ ME Department, LNCT, Bhopal, MP, India.

air to be supplied in a building. The physical phenomenon of earth air heat exchanger is simple: the ground temperature commonly higher than the outdoor air temperature in winter and lower in summer, so it makes the use of the earth convenient as warm or cold sink respectively. Both of the above uses of earth air heat exchanger can contribute to reduction in energy consumption. Several researchers have described the Earth-to-Air Heat Exchangers (EAHE) coupled with buildings as an effective passive energy source for building space conditioning. An earth-to-air heat exchanger system suitably meets heating and cooling energy loads of a building. Its performance is based upon the seasonally varying inlet temperature, and the tunnel-wall temperature which further depends on the ground temperature. The performance of an EAHE system depends upon the temperature and moisture distribution in the ground, as well as on the surface conditions.

WORKING PRINCIPAL OF EARTH TUBE HEAT EXCHANGER

The principal of using the principle of using ground inertia for heating and cooling is not a new concept, but rather a modified concept that goes back to the Ancients. This technology has been used throughout history from the ancient Greeks and Persians in the pre-Christian era until recent history (Santamouris and Asimakopoulos, 1996). For instance the Italians in the middle Ages used caves, called colvoli, to nprecool/preheat the air before it entered the building.

The system which is used nowadays consists of a matrix of buried pipes through which air is transported by a fan. In the summer

the supply air to the building is cooled due to the fact that the ground temperature around the heat exchanger is lower than the ambient temperature. During the winter, when the ambient temperature is lower than the ground temperature the process is reversed and the air gets preheated.

TYPES OF EARTH TUBE HEAT EXCHANGER

There are two types of heat exchanger:

1. Open type Earth tube heat exchanger
2. Closed type Earth tube heat exchanger

Open System


In open system, ambient air passes through tubes buried in the ground for preheating or pre-cooling and then the air is heated or cooled by a conventional air conditioning unit before entering the building.

Closed System

In this case heat exchangers are located underground, either in horizontal, vertical or oblique position, and a heat carrier medium is circulated within the heat exchanger, transferring the heat from the ground to a heat pump or vice versa.

LITERATURE REVIEW

The Heat transfer to and from Earth tube heatexchanger system has been the subject of many theoretical and experimental investigations. By having a review on previous research papers published by many authors we can have an idea on how it works. sehli *et al.* proposed a one-dimensional numerical model to check the performance of EAHEs installed at different depths. It was concluded that EAHE systems alone are not sufficient to

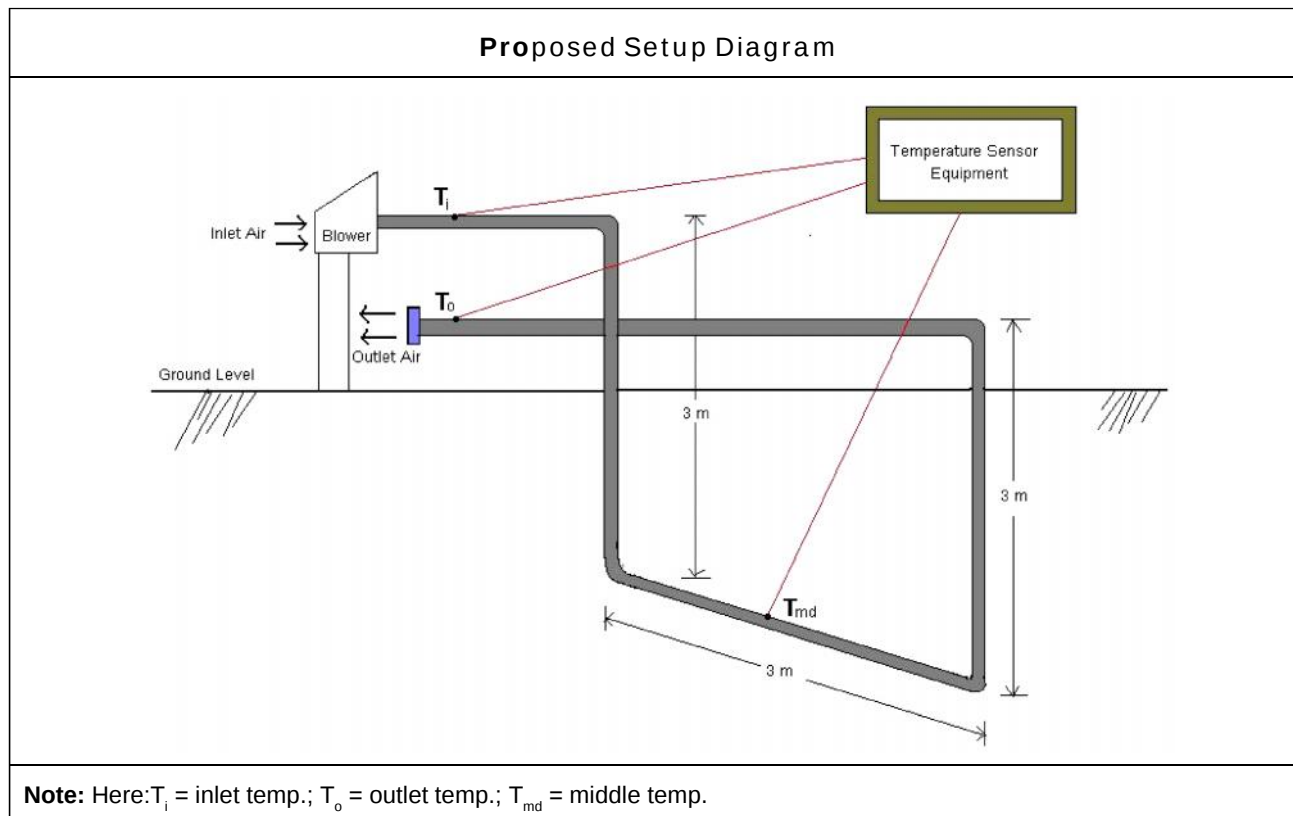

create thermal comfort, but can be used to reduce the energy demand in buildings in South Algeria, if used in combination with conventional airconditioning system.

Ghosal *et al.* developed a simplified analytical model to study year around effectiveness of an EAHE coupled greenhouse located in New Delhi, India. They found the temperature of greenhouse air on average 6-7 °C more in winter and 3-4 °C less in summer than the same greenhouse when operating without EAHE.

Shukla *et al.* developed a thermal model for heating of greenhouse by using different combinations of inner thermal curtain, an earth-air heat exchanger, and geothermal heating.

Bansal *et al.* investigated the performance analysis of EAHE for summer cooling in Jaipur, India. They discussed 23.42 m long EAHE at

cooling mode in the range of 8.0-12.7 °C and 2-5 m/s flow rate for steel and PVC pipes. They showed performance of system is not significantly affected by the material of buried pipe instead it is greatly affected by the velocity of air fluid. They observed COP variation 1.9-2.9 for increasing the velocity 2-5 m/s.

Santamouris *et al.* investigated the impact of different ground surface boundary conditions on the efficiency of a single and a multiple parallel earth-to-air heat exchanger system.

EXPERIMENTAL SETUP

The experimental setup is an open loop flow system has been designed and fabricated to conduct experimental investigation on the temperature difference for inlet and Outlet section, heat transfer, coefficient of performance and fluid flow characteristics of

a pipe in parallel connection. The experimental data are to be used to find the increase of cooling rate for the summer (May 2014) condition, and heating rate of winter (November 2014) condition heat transfer coefficient.

The Earth Tube Heat Exchanger Taken One horizontal pipe of 50 mm inner diameter with total length of 9 m. Three pipe each length of 3 m are connected in Series connection, made up of GI pipes and buried at a depth of 3 m in a flat land with dry soil. The Series connection of GI pipes exhaust manifold for air passage. Ambient air was sucked through the pipe by means of a centrifugal blower by a 2 phase, 0.25 hp, 230 V and 2800 rpm motor. The blower is used to suck the hot ambient air through the pipelines and delivered the cool air for required place in Summer (May 2014) climate and hot air required place in winter (November 2014).

CONCLUSION

In this paper the performance of earth air heat exchanger system was investigated and we have observed the following.

1. If the length of the pipe is so small and the blower is high voltage then the system is useless because the temperature difference between inlet and out let is very less.
2. The material of pipe is not affected in the output result.
3. If cooling or heating rate is more achieve, then the length of pipe kept at least 100 m and blower some around 400 W. 🌀

REFERENCES

1. Baxter D O (1992), "Energy Exchange and Related Temperature of an Earth-Tube Heat Exchanger in Heating Mode", Vol. 35, No. 1, pp. 275-285, Trans. ASAE.
2. Baxter D O (1994), "Energy Exchange and Related Temperature of an Earth-Tube Heat Exchanger in Cooling Mode", Vol. 37, No. 1, pp. 257-267, Trans. ASAE.
3. Capozza A, De Carli M and Zarrella A (2012), "Design of Borehole Heat Exchangers for Ground-Source Heat Pump: A Literature Review, Methodology Comparison and Analysis on the Penalty Temperature", *Energy and Buildings*, Vol. 55, No. 12, pp. 369-379.
4. Esen H, Inalli M and Esen M (2007a), "Numerical and Experimental Analysis of a Horizontal Ground-Coupled Heat Pump System", *Building and Environment*, Vol. 42, pp. 1126-1134.
5. Esen H, Inalli M, Esen M and Pihtili K (2007b), "Energy and Exergy Analysis of a Ground- Coupled Heat Pump System with Two Horizontal Ground Heat Exchangers", *Building and Environment*, Vol. 42, pp. 3606-3615.
6. Hellström G (1991), "Ground Heat Storage, Thermal Analysis of Duct Storage Systems: Theory", Doctoral Thesis, Department of Mathematical Physics, University of Lund, Sweden.
7. Kim S K, Bae G O, Lee K and Song Y (2010), "Field-Scale Evaluation of the Design of Borehole Heat Exchangers for the Use of Shallow Geothermal Energy", *Energy*, Vol. 35, No. 2, pp. 491-500.

8. Nam Y, Ooka R and Hwang S (2008), "Development of a Numerical Model to Predict Heat Exchange Rates for a Ground-Source Heat Pump System", *Energy and Buildings*, Vol. 40, No. 12, pp. 2133-2140.
9. Santamouris M, Mihalakaha G, Balaras C A, Argirioua Asimakopoulos D and Vallinaras M (1995), "Use of Buried Pipes for Energy Conservation in Cooling of Agricultural Greenhouse", *Solar Energy*, Vol. 35, pp. 111-124.
10. Scott N R, Parsons R A and Kochler T A (1965), "Analysis and Performance of an Earth-Tube Heat Exchanger", ASAE Paper No. 65-840. St. Joseph, Michigan, ASAE.
11. Sharan G and Jadhav R (2003), "Soil Temperature Regime at Ahmedabad", *Journal of Agricultural Engineering*, (forthcoming).
12. Spengler R W and Stombaugh D P (1983), "Optimization of Earth-Tube Heat Exchanger for Winter Ventilation of Swine Housing", pp. 1186-1193, Trans. ASAE.
13. Yavuzturk C, Spitler J D and Rees S J (1999), "A Transient Two-Dimensional Finite Volume Model for the Simulation of Vertical U-Tube Ground Heat Exchangers", *ASHRAE Transactions*, Vol. 105, No. 2, pp. 465-474.
14. Zarrella A, Scarpa M and De Carli M (2011a), "Short Time-Step Performances of Coaxial and Double U-Tube Borehole Heat Exchangers: Modeling and Measurements", *HVAC&R Research*, Vol. 17, No. 6, pp. 959-976.
15. Zarrella A, Scarpa M and De Carli M (2011b), "Short Time Step Analysis of Vertical Ground-Coupled Heat Exchangers: The Approach of CaRM", *Renewable Energy*, Vol. 36, No. 9, pp. 2357-2367.
16. Zarrella A and De Carli M (2013), "Heat Transfer Analysis of Short Helical Borehole Heat Exchangers", *Applied Energy*, Vol. 102, No. 2, pp. 1477-1491.
17. Zeng H, Diao N and Fang Z (2002), "A Finite Line-Source Model for Boreholes in Geothermal Heat Exchangers", *Heat Transfer-Asian Research*, Vol. 31, pp. 558-567.